

[REDACTED]

[REDACTED]

橋 本 好 治

[REDACTED]




[REDACTED]

[REDACTED]

For Safety in Oxygen Plants


Makoto Yoshimura

[REDACTED]

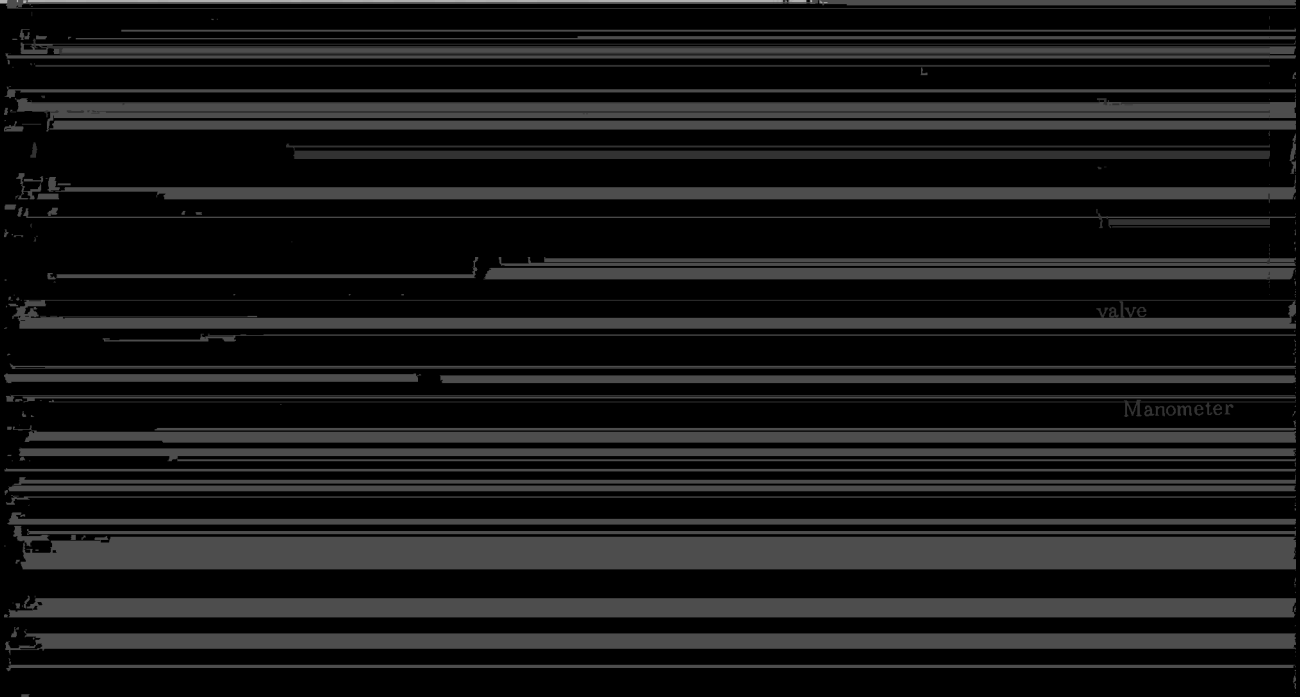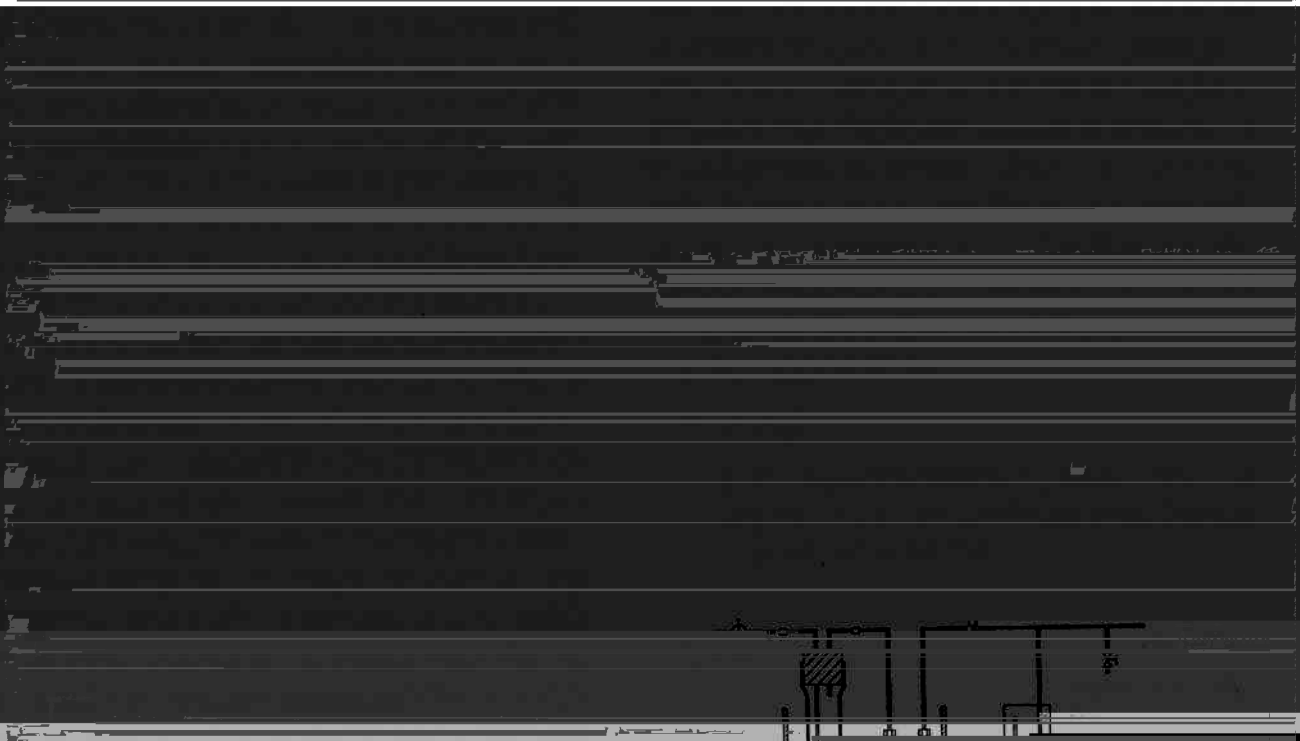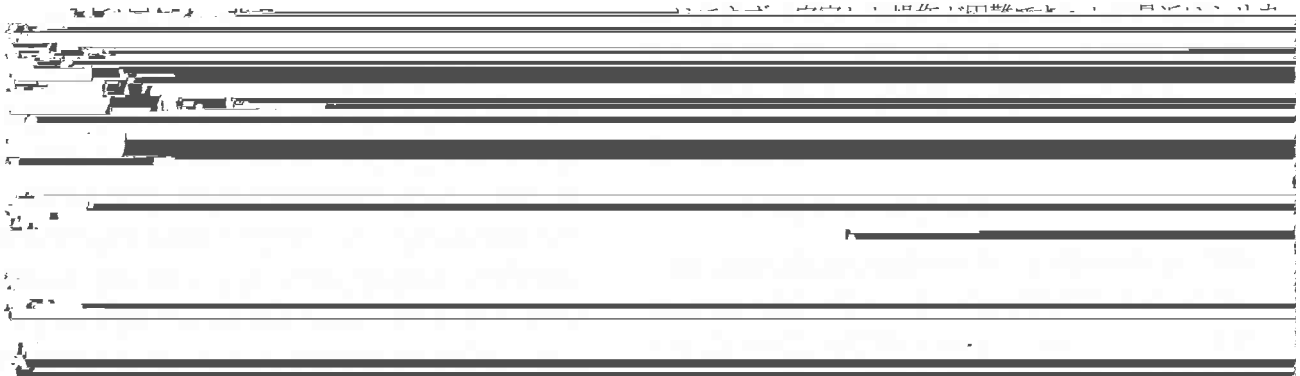

valve


Manometer

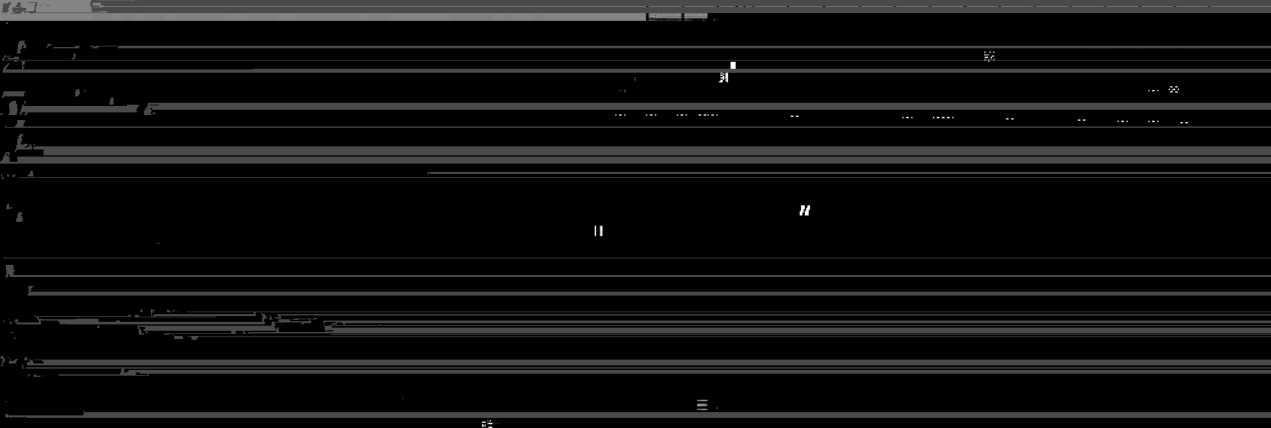

(4) Clean air source

C<sub>2</sub>H<sub>2</sub>

(5) Hydrogen flame ionizer

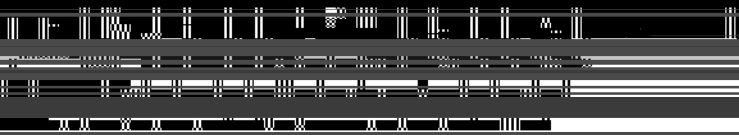

(6) Dummy substance

一切禁じて分析を行い、得られたクロマトグラム

リアボキシンのピーク面積が最も大きいことが

(7) Dummy C<sub>6</sub>H<sub>6</sub>



10%	$\text{CrSO}_4$	soln.	12ml
15%	$\text{H}_2\text{O}_2 \cdot \text{HCl}$	soln.	34ml
20%	$\text{NH}_4\text{OH}$	soln.	6ml
		total	52ml

concentration of Acetylene: ppb  
 1200  
 1000  
 800  
 600  
 400  
 200  
 0

glass wool plug

標準管の比較用

Length of detector tube 200mm

Inner diameter of tube 4 mm

Length of chemical bed 90mm

5. あとがき

文 献

徳島大学紀要